

ZAVOD ZA GRADBENIŠTVO SLOVENIAN NATIONAL BUILDING AND CIVIL ENGINEERING SLOVENIJE INSTITUTE

#### Dimičeva 12, 1000 Ljubljana, Slovenija

Tel.: +386 (0)1 280 44 72, +386 (0)1-280 45 37 Fax: +386 (0)1 280 44 84 e-mail: info.ta@zag.si http://www.zag.si

# **European Technical** Assessment

English version prepared by ZAG

#### **General Part**

**Technical Assessment Body issuing the European Technical Assessme** 

Trade name of the constructio

Product family to which the co product belongs

Manufacturer

Manufacturing plant

#### This European Technical Asse contains

This European Technical Asse issued in according to Regula No 305/2011, on the basis of

#### This version replaces

such.

according to Article 29 of Regulation (EU) No 305/2011

Član Member of



ETA-10/0425

of 13.03.2024

ent	
n product	FM-X5
onstruction	33: Plastic anchor for multiple use in concrete and masonry for non-structural applications
	FRIULSIDER S.p.A. via Trieste, 1 33048 San Giovanni al Natisone (UD) Italy www.friulsider.com
	via Trieste, 1 33048 San Giovanni al Natisone (UD) Italy www.friulsider.com
essment	20 pages including 3 annexes, which form an integral part of the document
essment is tion (EU)	EAD 330284-00-0604, Edition June, 2018

ZAG Ljubljana

ETA-10/0425 issued on 21.08.2019 Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

#### **Specific parts**

#### **1** Technical description of the product

The FM-X5 is a plastic anchor consisting of a plastic sleeve made of polyamide and an accompanying specific screw made of carbon galvanized steel or of stainless steel.

The plastic sleeve is expanded by screwing in the specific screw which presses the sleeve against the wall of the drilled hole.

The installed anchor is shown in Annex A(1/3).

# 2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

The performances given in Chapter 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the manufacturer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

# 3 Performance of the product and references to the methods used for this assessment

#### 3.2 Safety in case of fire (BWR 2)

According to the Technical Report TR 020 "Evaluation of anchorages in concrete concerning resistance to fire" it can be assumed that for fastening of facade systems the load bearing behaviour of the Plastic anchor FM-X5  $\phi$  10 has a sufficient resistance to fire at least 90 minutes (R90) if the admissible load  $[F_{Rk}/(\gamma_M \times \gamma_F)]$  is  $\leq$  0,8 kN (no permanent centric tension load).

#### 3.4 Safety in use (BWR 4)

The basic work requirements for safety in use are listed in Annexes C(1/12) and C(12/12).

#### 3.8 General aspects relating to fitness for use

Durability and serviceability are only ensured if specifications of intended use according to Annex B(1/2) are kept.

#### 4 Assessment and verification of constancy of performance (AVCP)

According to the decision 97/463/EC of the European Commission<sup>1</sup> the system of assessment and verification of constancy of performance (see Annex V to regulation (EU No 305/2011) 2+ apply.

ETA-10/0425, issued on 13.03.2024, Page 2 of 20

Official Journal of the European Communities L 198 of 25.07.1997


# 5 Technical details necessary for the implementation of the AVCP system, as provided in the applicable European Assessment Document


Technical details necessary for the implementation of the AVCP system are laid down in the Control plan deposited at the Slovenian National Building and Civil Engineering Institute (ZAG Ljubljana).

Issued in Ljubljana on 13.03.2024

Signed by: Franc Capuder, M.Sc.

Head of Service of TAB

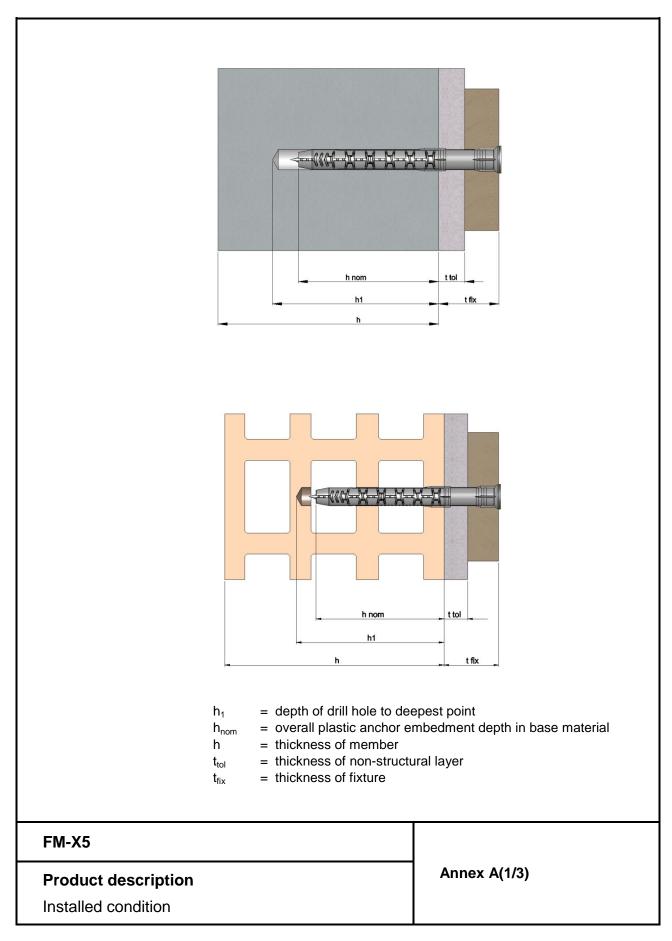

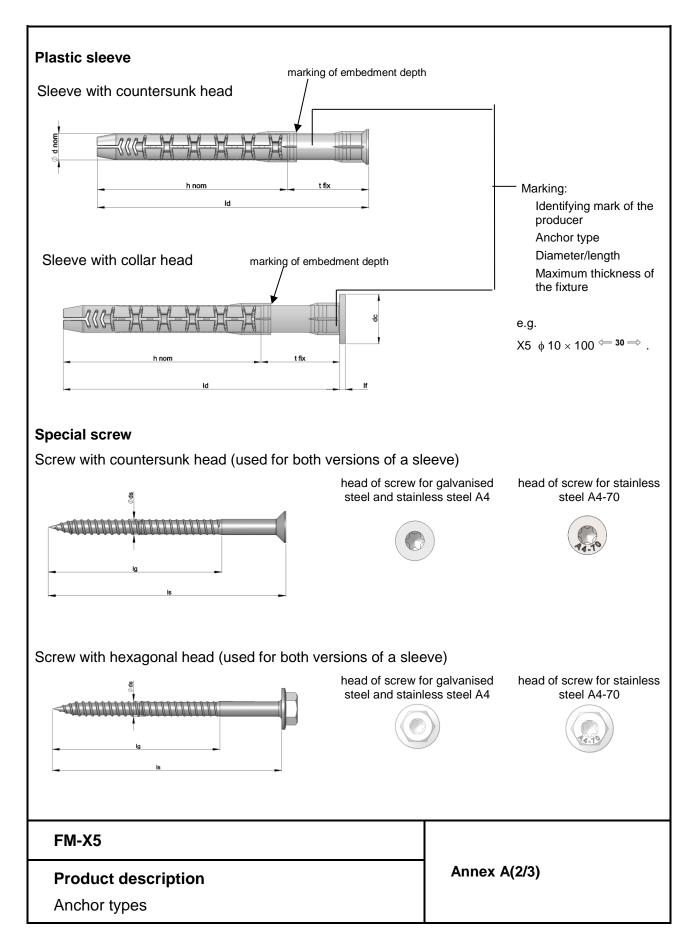

#### Table A1: Anchor dimensions

Anchor type			FM-X5 8	FM-X5 10
Overal plastic anchor embedment depth	$h_{nom} \ge$	[mm]	70	70
Plastic sleeve				
Plastic sleeve diameter	d <sub>nom</sub>	[mm]	8	10
Length of plastic sleeve	l <sub>d</sub>	[mm]	80-170	85-270
Diameter of collar head	d <sub>c</sub>	[mm]	-	18
Thickness of collar head	l <sub>f</sub>	[mm]	-	2,2
Thickness of fixture	t <sub>fix</sub>	[mm]	1-100	1-200
Special screw				
Screw diameter	ds	[mm]	6	7
Length of screw	l <sub>s</sub>	[mm]	85-175	90-275
Minimum length of thread	ا	[mm]	75	75

### Table A2: Materals

Part	Material			
Anchor sleeve	Polyamide PA 6 acc. To ISO 1874 - grey color			
Special screw	$\begin{array}{c} \mbox{steel $\phi$ 7;} \\ \mbox{galvanized $5 \mu m acc. to EN ISO 4042 grey galvanic coating 10 $\mu m$} \\ \mbox{acc. to EN ISO 4042; $f_{uk} \ge 600 $MPa$, $f_{yk} \ge 480 $MPa$} \\ \mbox{stainless A4 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 580 $MPa$, $f_{yk} \ge 470 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{steel $\phi$ 6;} \\ \mbox{galvanized $5 \mu m acc. to EN ISO 4042 $grey $galvanic $coating 10 $\mu m$ $acc. to EN ISO 4042; $f_{uk} \ge 520 $MPa$, $f_{yk} \ge 420 $MPa$ \\ \mbox{stainless A4 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 580 $MPa$, $f_{yk} \ge 470 $MPa$ \\ \mbox{stainless A4 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 470 $MPa$ \\ \mbox{stainless A4 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578, $f_{uk} \ge 700 $MPa$, $f_{yk} \ge 450 $MPa$ \\ stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578 or 1.4578 \\ \mbox{stainless A4-70 - 1.4401 or 1.4404 or 1.4571 or 1.4578 or 1.4$			
FM-X5				
Product o	lescription	Annex A(3/3)		
Dimensior	ns and materials			

#### Specifications of intended use

#### Anchorages subject to:

- Static and quasi static load
- Multiple fixing for non-structural applications

#### Base materials:

- Reinforced and non-reinforced normal weight concrete C12/15 to C50/60 (use category A) according EN 206: 2013+A1:2016;
- Solid masonry (use category B), according to Annex C(1/12) and C(3/12);
- Hollow or perforated masonry (use category C) according to Annex C(1/12), C(4/12)-C(10;/12)
- Mortar strength class of the masonry has to be at least M 2,5 according to EN 998-2: 2003;
- Autoclaved Aerated Concrete (use category D) according to Annex C(1/12) and C(11/12);
- For other base materials of the use categories A, B, C and D the characteristic resistance of the anchor may be determined by job site tests according to EOTA TR 051, Edition April 2018.

#### Temperature range:

- a: -40°C to +40°C (max. long term temperature +24°C and max. short term temperature +40°C)
- b: -40°C to +80°C (max. long term temperature +50°C and max. short term temperature +80°C)

#### Use conditions (Environmental conditions):

- The specific screw made of galvanized steel may only be used in structures subject to dry internal conditions.
- The specific screw made of stainless steel may be used in structures subject to dry internal conditions and also in structures subject to external atmospheric exposure (including industrial and marine environment), or exposure in permanently damp internal conditions, if no particular aggressive conditions exist. Such particular aggressive conditions are e. g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e. g. in desulphurization plants or road tunnels where de-icing materials are used).

#### Design:

- The design of anchorages is carried out in compliance with Technical Report TR 064:2018-05, under the responsibility of an engineer experienced in anchorages
- Verifiable calculation notes and drawings shall be prepared taking account of the loads to be anchored, the nature and strength of the base materials and the dimensions of the anchorage members as well as of the relevant tolerances.

#### Installation:

- Anchor installation carried out by appropriately qualified personnel under the supervision of the person responsible for technical matters on site.
- Anchor installation in accordance with the manufacturer's specifications and drawings using the tools indicated in this European Technical Approval
- Drilling method according Annex C(3/12) to C(11/12) for use category A, B, C and D.
- Temperature during installation of the anchor ≥ -20 °C (plastic sleeve and base material)
- Checks before placing the anchor, to ensure that the characteristic values of the base material in which the anchor is to be placed, is identical with the values, which the characteristic loads apply for.
- Placing drill holes without damaging the reinforcement.
- Holes to be cleaned of drilling dust.
- In case of aborted hole: New drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted drill hole is filled with high strength mortar.
- The plastic sleeve is inserted through the fixture by slight hammer blows and the special screw is screwed in until the head of the screw touches the sleeve. The anchor is correct mounted, if there is no turn-through of the plastic sleeve in the drill hole and if slightly move on turning of the screw is impossible after the complete turn-in of the screw.

FM-X5

Annex B(1/2)

Intended use

Specification

# Table B1: Installation parameters

Anchor type			FM-X5 8	FM-X5 10
Drill hole diameter	d <sub>0</sub> =	[mm]	8	10
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	8,45	10,45
Depth of frill hole to deepest point	$h_1 \geq$	[mm]	80	80
Overal plastic anchor embedment depth <sup>1)</sup>	h <sub>nom</sub>	[mm]	70	70
Diameter of clearance hole in the fixture	d <sub>f</sub>	[mm]	8,5	10,5


<sup>1)</sup> See Annex A(1/1)

Table B2: Minimum thickness of member, edge distance and anchor spacing in concrete

FM-X5	Concrete C12/15	Concrete ≥ 16/20		
Minimum thickness of member	h <sub>min</sub>	[mm]	100	100
Minimum anaging and adap distance	C <sub>min</sub>	[mm]	80	60
Minimum spacing and edge distance		[mm]	80	60
Characteristic edge distance	C <sub>cr,N</sub>	[mm]	140	100

**Table B3:** Minimum thickness of member, edge distance and anchor spacing in masonry

FM-X5	FM-X5				
Minimum thickness of member	h <sub>min</sub>	[mm]	106 <sup>2)</sup>		
Single anchor					
Minimum spacing	S <sub>min</sub>	[mm]	250		
Minimum edge distance	C <sub>min</sub>	[mm]	100		
Anchor group	•				
Spacing perpendicular to free edge	S1 <sub>min</sub>	[mm]	200		
Spacing parallel to free edge	S2 <sub>min</sub>	[mm]	400		
Minimum edge distance	C <sub>min</sub>	[mm]	100		
ee Annexes C(3/12) to C(10/12)					
	h				

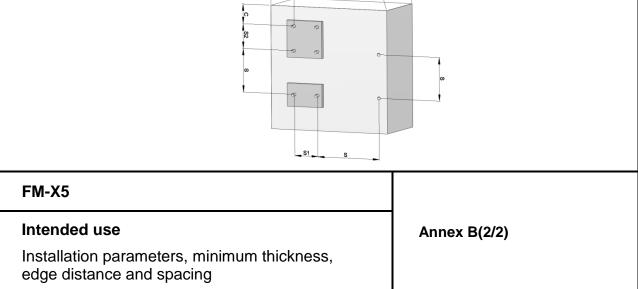

Base ma	Base material		Dimensions L×B×H [mm] [MPa]		1	Bulk density class [kg/dm <sup>3</sup> ]		Annex	
			Cor	ncrete					0(0(10)
Concrete ≥ C12	/15			E	N 206			Annex	C(2/12)
Solid masonry	_								
Solid brick acc. t EN 771-1		251×120	×55	4	43,77		≥ 1,8	Annex	C(3/12)
Hollow or perfo									
Hollow clay brick acc. to EN 771-1		250×120×120			27,30		≥ 1,0	Annex	C(4/12)
Hollow clay brick svizzero pesante acc. to EN 771-1	9	300×250×190			13,83		≥ 0,9	Annex	C(5/12)
Hollow clay brick incastro 35 acc.to EN 771-1		350×240>	<245		10,93		≥ 0,8	Annex	C(6 /12)
Hollow clay brick leggero acc. to EN 771-1		250×120	20 500 7			≥ 0,5	Annex	C(7/12)	
Hollow clay brick acc.to EN 771-1	c – poroton	250×300×190 22		22		≥ 0,9 Annex C(		C(8/12)	
Hollow clay brick category 1 – HD acc.to EN 771-1		224×106×54		30			≥ 1,3	Annex C(9/12)	
Hollow brick ligh concrete BC 203 acc.to EN 771-3	3 n°26	490×200>	<190		4		≥ 0,95	Annex C(10/12	
Autoclaved Aera – AAC gasbeton	ted Concrete	625×250>	<200		2,5		≥ 0,50	Annex C(11/12	
able C2: Chara Autoc	acteristic bend claved Aerated		nce of	f the s					
		Galvani	-		-	Α		A	ess steel 4-70
<u> </u>		FM-X5 8	FM-)	(5 10	FM-X5	8	FM-X5 10	FM-X5 8	FM-X5 1
Characteristic bending resistance	M <sub>Rk,s</sub> [Nm]	8,61	16	,84	9,60		21,95	13,57	24,78
Partial safety factor	1) γ <sub>Ms</sub>	1,23	1,	25	.5 1,25		1,25	1,56	1,56
In absence of othe	er national regulat	ions							
FM-X5									
Performance							Annex C(1/	12)	

Table C3: Characteristic resistance for use in	1 concrete
--	------------

Anchor type				F	M-X5 8		FM-X5 10		
Steel failure (sp	ecial screw)			Galvan.		ss steel	Galvan.	Stainles	
	2			steel	A4	A4-70	steel	A4	A4-70
Characteristic ter		N <sub>Rk,s</sub>	[kN]	11,0	12,3	16,5	18,1	21,2	25,0
Partial safety fact		γ́Ms ́	[-]	1,48	1,48	1,88	1,50	1,48	1,88
Characteristic sh		V <sub>Rk,s</sub>	[kN]	5,52	6,16				12,5
Partial safety fact		γ <sub>Ms</sub> 1)	[-]	1,23	1,23	1,56	1,25	1,25	1,56
Pull-out failure (	1 1								
Concrete ≥ C16/				T			r		
Characteristic	24°C <sup>2)</sup> /40°C <sup>3)</sup>	N <sub>Rk,p</sub>	[kN]		2,5			3,5	
resistance	50°C <sup>2)</sup> /80°C <sup>3)</sup>	N <sub>Rk,p</sub>	[kN]		1,2			2,5	
Partial safety fact		1) γ <sub>Mc</sub>	[-]				1,8		
Concrete C12/15				1					
Characteristic	24°C <sup>2)</sup> /40°C <sup>3)</sup>	N <sub>Rk,p</sub>	[kN]		1,5			2,5	
resistance	50°C <sup>2)</sup> /80°C <sup>3)</sup>	N <sub>Rk,p</sub>	[kN]		0,75			1,5	
Partial safety fact	tor	γ <sub>Mc</sub> 1)	[-]				1,8		
	ilure and concrete	edge fai	ilure for	single and	chor and	anchor	group		
Tension load <sup>4)</sup>									
$N_{Rk,c} = 7, 2 \cdot \sqrt{f_{ck,cube}}$	$\cdot \mathbf{h}_{ef}^{1,5} \cdot \frac{\mathbf{C}}{\mathbf{C}_{cr,N}} = \mathbf{N}_{Rkp} \cdot \frac{\mathbf{C}}{\mathbf{C}_{cr}}$	:r,N				with:	$h_{ef}^{1,5} = \frac{1}{7}$ $\frac{c}{c_{crN}} \leq \frac{1}{7}$	γ <b>γ</b> cκ,cu	, be
Shear load <sup>4)</sup>							C <sub>cr,N</sub>		
	$\cdot \left(\frac{h_{\text{nom}}}{d_{\text{nom}}}\right)^{\!\!0,2} \cdot \sqrt{f_{\text{ck,cube}}}$	×c <sub>1</sub> <sup>1,5</sup> ×0,5	$\times \sqrt{\frac{c_2}{1,5c_1}}$	$\sqrt{\frac{h}{1,5c_1}}$		with	$\sqrt{\frac{c_2}{1,5c_1}}$		
		4	1				$\sqrt{\frac{h}{1,5 c_1}}$	- ≤ 1	
c <sub>2</sub> edge dist	ance closest to th ance perpendicula characteristic conc n	ar to dire	ction 1	-		on cube	es), values	s for C50/	60 at
Partial safety fact	tor	γ	1) Mc	[-]			1,8		
In absence of other n Maximum long term t Maximum short term The design method a	emperature				e used				
FM-X5									
Performanc	е					Annex	C(2/12)		
Characteristi (use categor	c resistance in y A)	concret	te						

#### Base material solid masonry: Solid brick

Table C4: Brick data

Description of brick		
Type of brick		Solid brick
Bulk density $\rho \ge$	[kg/dm <sup>3</sup> ]	1,8
Standard		EN 771-1
Format (measurement)	[mm]	≥ 250/120/55
Minimum thickness of member h <sub>min</sub>	[mm]	120

#### Table C5: Installation parameters

Anchor size			FM-X5 8	FM-X5 10
Drill hole diameter	$d_0 =$	[mm]	8	10
Cutting diameter of drill bit	d <sub>cut</sub> ≤	[mm]	8,45	10,45
Depth of drill hole to deepest point	$h_1 \ge$	[mm]	80	
Drill method		[-]	Hamme	er drilling
Overall plastic embedment depth	h <sub>nom</sub> =	[mm]	70	
Diameter of clearance hole in the fixture	d <sub>f</sub>	[mm]	8,5	10,5

#### **Table C6:** Characteristic resistance $F_{Rk}^{(1)}$ for single anchor

Anchor size			FM-X5 8	FM-X5 10
Solid clay brick f <sub>b</sub> ≥ 43,77 MPa	24°C <sup>3)</sup> /40°C <sup>4)</sup>	[kN]	3,5	3,5
Characteristic resistance F <sub>Rk</sub>	50°C <sup>3)</sup> /80°C <sup>4)</sup>	[kN]	2,0	2,5
Partial safety factor	2) γ <sub>Mm</sub>	[-]	2,5	

<sup>1)</sup> Characteristic resistance  $F_{Rk}$  for tension, shear or combined tension and shear loading. The characteristic resistance is valid for single plastic anchor or for group of two or four plastic anchors with a spacing equal or larger than the minimum spacing  $s_{min}$  according to Table B3. The specific conditions for the design method have to be considered according to Annex B(1/2).

<sup>2)</sup> In absence of other national regulations

<sup>3)</sup> Maximum long term temperature <sup>4)</sup> Maximum short term temperature

FM-X5

#### Performance

Characteristic resistance in solid brick (use category B)

Annex C(3/12)


#### ETA-10/0425, issued on 13.03.2024, Page 11 of 20

E-00768/24

# Base material hollow masonry: Hollow clay brick - Bimattone

#### Table C7: Brick data

Description of brid	:k	
Type of brick		Hollow clay brick -Bimattone
Bulk density $\rho \ge$	[kg/dm <sup>3</sup> ]	0,9
Standard		EN 771-1
Producer of brick		Fornaci Giuliane S.p.a
		34071 Cormons (Go) Italy
Format (measurement)	[mm]	≥ 250/120/120
Minimum thickness of member h <sub>min</sub>	[mm]	120



# Table C8: Installation parameters

Anchor size			FM-X5 8	FM-X5 10
Drill hole diameter	d <sub>0</sub> =	[mm]	8	10
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	8,45	10,45
Depth of drill hole to deepest point	$h_1 \geq$	[mm]	80	)
Drill method		[-]	Rotary	drilling
Overall plastic embedment depth	h <sub>nom</sub> =	[mm]	70	)
Diameter of clearance hole in the fixture	df	[mm]	8,5	10,5


**Table C9:** Characteristic resistance  $F_{Rk}^{(1)}$  for single anchor

Anchor siz	е		FM-X5 8	FM-X5 10
Hollow brick - Bimattone $f_b \ge 27,3$ MPa	24°C <sup>3)</sup> /40°C <sup>4)</sup>	[kN]	1,5	1,5
Characteristic resistance F <sub>Rk</sub>	50°C <sup>3)</sup> /80°C <sup>4)</sup>	[kN]	0,9	1,2
Partial safety factor	2) γMm	[-]	2	,5
according to Table B3. The specific conditions for the <sup>2)</sup> IN absence of other national regulations <sup>3)</sup> Maximum long term temperature <sup>4)</sup> Maximum short term temperature <b>FM-X5</b>	e design method have to	be considered a	ccording to Annex	B(1/2).
		-		
Performance		Anno	ex C(4/12)	

### Base material hollow masonry: Hollow clay brick - Alveolater svizzero pesante

#### Table C10: Brick data

Description o	f brick		
Type of brick			Hollow clay brick Alveolater svizzero pesante
Bulk density	ρ≥	[kg/dm <sup>3</sup> ]	0,9
Standard			EN 771-1
Producer of brick			Fornaci Giuliane S.p.a 34071 Cormons (Go) Italy
Format (measurement)		[mm]	≥ 300/250/190
Minimum thickness of member	h <sub>min</sub>	[mm]	250



#### Table C11: Installation parameters

Anchor size			FM-X5 8	FM-X5 10
Drill hole diameter	d <sub>0</sub> =	[mm]	8	10
Cutting diameter of drill bit	d <sub>cut</sub> ≤	[mm]	8,45	10,45
Depth of drill hole to deepest point	$h_1 \geq$	[mm]	8	0
Drill method		[-]	Rotary	drilling
Overall plastic embedment depth	h <sub>nom</sub> =	[mm]	7	0
Diameter of clearance hole in the fixture	d <sub>f</sub>	[mm]	8,5	10,5


**Table C12:** Characteristic resistance  $F_{Rk}^{(1)}$  for single anchor

Anchor size	e		FM-X5 8	FM-X5 10
Hollow brick - Alveolater svizzero	24°C <sup>3)</sup> /40°C <sup>4)</sup>	[kN]	1,5	1,5
<b>pesante f<sub>b</sub> ≥ 13,83 MPa</b> Characteristic resistance F <sub>Rk</sub>	50°C <sup>3)</sup> /80°C <sup>4)</sup>	[kN]	0,6	1,2
Partial safety factor	2) γMm	[-]	2	,5
according to Table B3. The specific conditions for the IN absence of other national regulations Maximum long term temperature Maximum short term temperature	e design method have to l	be considered a	ccording to Annex	B(1/2).
FM-X5				
Derfermence				
Performance		Anne	x C(5/12)	

#### Base material hollow masonry: Hollow clay brick - Alveolater incastro 35

# Table C13: Brick data

Description	of brick		
Type of brick			Hollow clay brick Alveolater incastro 35
Bulk density	ρ≥	[kg/dm <sup>3</sup> ]	0,8
Standard			EN 771-1
Producer of brick			Fornaci Giuliane S.p.a 34071 Cormons (Go) Italy
Format (measurement)		[mm]	≥ 350/240/245
Minimum thickness of member	h <sub>min</sub>	[mm]	350



### Table C14: Installation parameters

Anchor size			FM-X5 8	FM-X5 10
Drill hole diameter	d <sub>0</sub> =	[mm]	8	10
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	8,45	10,45
Depth of drill hole to deepest point	$h_1 \geq$	[mm]		80
Drill method		[-]	Rotar	y drilling
Overall plastic embedment depth	h <sub>nom</sub> =	[mm]		70
Diameter of clearance hole in the fixture	d <sub>f</sub>	[mm]	8,5	10,5


**Table C15:** Characteristic resistance  $F_{Rk}^{(1)}$  for single anchor

Anchor siz	e		FM-X5 8	FM-X5 10
Hollow brick - Alveolater incastro 35	24°C <sup>3)</sup> /40°C <sup>4)</sup>	[kN]	1,5	1,5
f <sub>b</sub> ≥ 10,93 MPa Characteristic resistance F <sub>Rk</sub>	50°C <sup>3)</sup> /80°C <sup>4)</sup>	[kN]	0,75	1,2
Partial safety factor	2) γMm	[-]	2	2,5
according to Table B3. The specific conditions for th IN absence of other national regulations Maximum long term temperature Maximum short term temperature FM-X5	e design method have to l	be considered a	according to chapt	er Annex B(1/2).
LINI-VQ				

### Base material hollow masonry: Hollow clay brick - Blocco leggero

#### Table C16 Brick data

Desc	ription of brick		
Type of brick			Hollow clay brick Blocco leggero
Bulk density	$\rho \ge$	[kg/dm <sup>3</sup> ]	0,5
Standard			EN 771-1
Producer of brick			Wienerberger Brunori SRL Burbano di Modano (Bo) Italy
Format (measurement)		[mm]	≥ 250/120/500
Minimum thickness of member	h <sub>min</sub>	[mm]	120



### Table C17: Installation parameters

Anchor size			FM-X5 8	FM-X5 10
Drill hole diameter	d <sub>0</sub> =	[mm]	8	10
Cutting diameter of drill bit	d <sub>cut</sub> ≤	[mm]	8,45	10,45
Depth of drill hole to deepest point	$h_1 \ge$	[mm]	ä	80
Drill method		[-]	Rotary	/ drilling
Overall plastic embedment depth	h <sub>nom</sub> =	[mm]		70
Diameter of clearance hole in the fixture	d <sub>f</sub>	[mm]	8,5	10,5

**Table C18:** Characteristic resistance  $F_{Rk}^{(1)}$  for single anchor

Anchor size	1		FM-X5 8	FM-X5 10
Hollow brick - Blocco leggero f <sub>b</sub> ≥ 7 MPa	24°C <sup>3)</sup> /40°C <sup>4)</sup>	[kN]	0,9	0,9
Characteristic resistance F <sub>Rk</sub>	50°C <sup>3)</sup> /80°C <sup>4)</sup>	[kN]	0,4	0,6
Partial safety factor	2) γMm	[-]		2,5
Characteristic resistance F <sub>Rk</sub> for tension, shear or com		loading. The c	haracteristic resis	1

# FM-X5

#### Performance

Characteristic resistance in hollow clay brick -Blocco leggero (use category C)


Annex C	;(7/12)
---------	---------

ETA-10/0425, issued on 13.03.2024, Page 15 of 20

#### Base material hollow masonry: Hollow clay brick - Poroton

#### Table C19: Brick data

Description of brick			
Type of brick			Hollow clay brick - Poroton
Bulk density	$\rho \ge$	[kg/dm <sup>3</sup> ]	0,9
Standard			EN 771-1
Producer of brick			Fornaci di Manzano S.p.a 33044 Manzano (Ud) Italy
Format (measurement)		[mm]	≥ 250/300/190
Minimum thickness of member	h <sub>min</sub>	[mm]	250



### Table C20: Installation parameters

Anchor size			FM-X5 8	FM-X5 10
Drill hole diameter	$d_0$	[mm]	10	10
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	10,45	10,45
Depth of drill hole to deepest point	$h_1 \geq$	[mm]		80
Drill method		[-]	Rotary	/ drilling
Overall plastic embedment depth	h <sub>nom</sub> =	[mm]	-	70
Diameter of clearance hole in the fixture	df	[mm]	10,5	10,5

**Table C21:** Characteristic resistance  $F_{Rk}^{1}$  for single anchor

Anchor size			FM-X5 8	FM-X5 10
Hollow brick - Poroton f <sub>b</sub> ≥ 22 MPa	24°C <sup>3)</sup> /40°C <sup>4)</sup>	[kN]	1,5	2,0
Characteristic resistance F <sub>Rk</sub>	50°C <sup>3)</sup> /80°C <sup>4)</sup>	[kN]	0,9	1,2
Partial safety factor	2) γMm	[-]	2	2,5
<ol> <li><sup>1)</sup> Characteristic resistance F<sub>Rk</sub> for tension, shear or consingle plastic anchor or for group of two or four plastic according to Table B3. The specific conditions for the</li> <li><sup>2)</sup> IN absence of other national regulations</li> <li><sup>3)</sup> Maximum long term temperature</li> <li><sup>4)</sup> Maximum short term temperature</li> </ol>	c anchors with a spacing	g equal or larger	than the minimum	n spacing s <sub>min</sub>

# FM-X5


#### Performance

Characteristic resistance in hollow clay brick -Poroton (use category C)

#### Base material hollow masonry: Hollow clay brick Leopard Brique Perforèe category 1-HD

#### Table C22: Brick data

Description of brick			
Type of brick			Hollow clay brick -
ype of blick			Leopard BP category 1-HD
Bulk density	ρ≥	[kg/m <sup>3</sup> ]	1,3
Standard			EN 771-1
			Pacema Groupe
Producer of brick			Wienerberge F- 67087
			Strasbourg
Format (measurement)		[mm]	≥ 220/120/54
Minimum thickness of member	h <sub>min</sub>	[mm]	120



# Table C23: Installation parameters

Anchor size			FM-X5 8	FM-X5 10
Drill hole diameter	$d_0$	[mm]	10	10
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	10,45	10,45
Depth of drill hole to deepest point	$h_1 \ge$	[mm]		80
Drill method		[-]	Rota	ry drilling
Overall plastic embedment depth	h <sub>nom</sub> =	[mm]		70
Diameter of clearance hole in the fixture	df	[mm]	10,5	10,5

**Table C24:** Characteristic resistance  $F_{Rk}^{(1)}$  for single anchor

Anchor size			FM-X5 8	FM-X5 10
Hollow clay brick - Leopard BP category	24°C <sup>3)</sup> /40°C <sup>4)</sup>	[kN]	2,0	1,5
<b>1HD</b> $f_b \ge 30$ MPa Characteristic resistance $F_{Rk}$	50°C <sup>3)</sup> /80°C <sup>4)</sup>	[kN]	0,9	0,9
Partial safety factor	2) γMm	[-]		2,5
single plastic anchor or for group of two or four plastic according to Table B3. The specific conditions for the or <sup>1)</sup> IN absence of other national regulations <sup>3)</sup> Maximum long term temperature <sup>4)</sup> Maximum short term temperature				
FM-X5 Performance		_		

#### Base material hollow masonry: Blocks creux granulate en beton allege Table C25: Brick data **Description of brick** Hollow brick light weight Type of brick concrete BC 203 n°26 Bulk density [kg/dm<sup>3</sup>] 0,95 $\rho \ge$ EN 771-3 Standard Carayon Producer of brick F-11590 Salleled d'Aude ≥ 490/200/190 Format (measurement) [mm] Minimum thickness of member h<sub>min</sub> 200 [mm] ŝ 134 Table C26: Installation parameters Anchor size FM-X5 8 FM-X5 10 Drill hole diameter $d_0$ [mm] 8 10 Cutting diameter of drill bit [mm] 8,45 10,45 $d_{\text{cut}} \leq$ Depth of drill hole to deepest point $h_1 \ge$ [mm] 80 Drill method Rotary drilling [-] Overall plastic embedment depth h<sub>nom</sub> = 70 [mm] Diameter of clearance hole in the fixture 8,5 10,5 df [mm] **Table C27:** Characteristic resistance $F_{Rk}^{1}$ for single anchor Anchor size FM-X5 8 FM-X5 10 Hollow brick BC 203 $n^{\circ}26$ $f_b \ge 4$ MPa 24°C<sup>3)</sup>/40°C<sup>4)</sup> 0,75 0,6 [kN] 50°C<sup>3)</sup>/80°C<sup>4)</sup> 0,6 Characteristic resistance F<sub>Rk</sub> 0,3 [kN] 2) γ<sub>Mm</sub> Partial safety factor [-] 2,5 Characteristic resistance F<sub>Rk</sub> for tension, shear or combined tension and shear loading. The characteristic resistance is valid for single plastic anchor or for group of two or four plastic anchors with a spacing equal or larger than the minimum spacing smin according to Table B3. The specific conditions for the design method have to be considered according to Annex B(1/2). <sup>2)</sup> In absence of other national regulations <sup>3)</sup> Maximum long term temperature <sup>4)</sup> Maximum short term temperature FM-X5 Performance Annex C(10/12) Characteristic resistance in hollow brick -Blocks creux granulate en beton allege (use category C)

#### **Base material: Autoclaved Aerated Concrete**

#### Table C28: Brick data

Description of brick		
Type of brick		Autoclaved aerated concrete
Bulk density $\rho \ge$	[kg/dm <sup>3</sup> ]	0,5
Standard		EN 771-4
Producer of brick		RDB Hebel S.p.A., Pontenure, Italia
Format (measurement)	[mm]	≥ 625/250/200
Minimum thickness of member h <sub>mir</sub>	[mm]	200

#### Table C29: Installation parameters

Anchor size			FM-X5 8	FM-X5 10
Drill hole diameter	d <sub>0</sub>	[mm]	8	10
Cutting diameter of drill bit	$d_{cut} \le$	[mm]	8,45	10,45
Depth of drill hole to deepest point	$h_1 \ge$	[mm]	8	30
Drill method		[-]	Hamme	er drilling
Overall plastic embedment depth	h <sub>nom</sub> =	[mm]	7	0
Diameter of clearance hole in the fixture	d <sub>f</sub>	[mm]	8,5	10,5

# **Table C30:** Characteristic resistance $F_{Rk}^{(1)}$ for single anchor

[kN]	0,6	0,6
[kN]	0,6	0,5
	· 	0
	[kN] [-]	

<sup>1)</sup> Characteristic resistance F<sub>Rk</sub> for tension, shear or combined tension and shear loading. The characteristic resistance is valid for single plastic anchor or for group of two or four plastic anchors with a spacing equal or larger than the minimum spacing s<sub>min</sub> according to Table B3. The specific conditions for the design method have to be considered according to Annex B(1/2).
 <sup>2)</sup> In absence of other national regulations

<sup>3)</sup> Maximum long term temperature

<sup>4)</sup> Maximum short term temperature

FM-X5	
<b>Performance</b> Characteristic resistance in Autoclaved Aerated Concrete (use category D)	Annex C(11/12)

	Т	ension loa	ad	Shear load			
Concrete $\geq$ C 16/20	F	$\delta_{N0}$	δ <sub>N∞</sub>	F	$\delta_{V0}$	δ <sub>V∞</sub>	
	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]	
FM-X5 8	1,0	3,76	7,52	1,0	1,60	2,40	
FM-X5 10	1,4	1,79	3,58	1,4	0,90	1,35	

# Table C31: Displacements under tension and shear loading in concrete

#### Table C32: Displacements under tension and shear loading in masonry

		Displacement				Displacement				
Base material	F	Tension load		Shear load		F	Tension load		Shear load	
		$\delta_{N0}$	δ <sub>N∞</sub>	$\delta_{V0}$	δ <sub>V∞</sub>		δ <sub>V∞</sub>	δ <sub>V∞</sub>	δ <sub>V∞</sub>	δ <sub>V∞</sub>
	[kN]	[mm]	[mm]	[mm]	[mm]	[kN]	[mm]	[mm]	[mm]	[mm]
	FM-X5 8					FM-X5 10				
Solid clay brick	0,86	1,74	3,48	0,71	1,10	1,00	2,40	4,80	0,83	1,25
Hollow clay brick - bimattone	0,43	1,81	3,62	0,86	1,29	0,43	1,70	3,40	0,86	1,29
Hollow clay brick – alveolater svizzero pesante	0,43	1,00	2,00	0,86	1,29	0,43	0,89	1,78	0,86	1,29
Hollow clay brick – alveolater 35	0,43	1,51	3,02	0,86	1,29	0,43	1,65	3,30	0,86	1,29
Hollow clay brick – blocco leggero	0,26	1,71	3,42	0,52	0,78	0,26	1,05	2,10	0,52	0,78
Hollow clay brick – poroton	0,43	1,80	3,60	0,86	1,29	0,57	1,61	3,22	0,86	1,29
Hollow clay brick – BP category 1 - HD	0,57	0,83	1,66	1,14	1,71	0,43	0,95	1,90	1,14	1,71
Hollow brick – light weight concrete – BC 203	0,21	2,32	4,64	1,00	1,50	0,17	1,59	3,18	0,34	0,51

# Table C33: Displacements under tension and shear loading in Autoclaved Aerated Concrete

		<b>Fension</b> load	d	Shear load			
AAC 2	F	δ <sub>N0</sub>	δ <sub>N∞</sub>	F	$\delta_{V0}$	δ <sub>V∞</sub>	
	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]	
FM-X5 8	0,21	0,94	1,88	0,18	1,00	1,50	
FM-X5 10	0,21	1,88	3,76	0,27	1,50	2,25	

#### FM-X5

Performance

### Ann

Annex C(12/12)

Displacements in concrete and masonry